

Sheet 15 of 36

1. FOR LEGEND, ABBREVIATIONS AND GENERAL NOTES, SEE DWG. E-02-1.
FOR INSTALLATION DETAILS, SEE DWG. E-02-4. FOR WIRING DIAGRAMS,
SEE DWG. E-02-5 AND E-02-6.
2. PRIOR TO CEILING DEMOLITION, ALL EXISTING SMOKE DETECTORS AND
ASSOCIATED WIRING SHALL BE SECURED UP IN THE CEILING TO ALLOW
SPACE FOR THE CONSTRUCTION. DURING THE ENTIRE CONSTRUCTION
PHASE, THE EXISTING SMOKE DETECTORS SHALL BE KEPT OPERATIONAL.
3. REMOVAL OF EXISTING SMOKE DETECTORS (THE ONES TEMPORARILY
SECURED IN THE CEILING) SHALL BE PERFORMED ONLY AFTER INSTALLED
SMOKE DETECTORS ARE TESTED AND OPERATIONAL.
4. SECTION C-C LOCATED AT FIRE ALARM CLOSET FC-NF-4, SEE DWG.
E-02-7 FOR INSTALLATION DETAILS OF PAD FLA-1 & FA-2.

ELECTRICAL PROGRAM MANAGER
WORK TRADE
[Signature]
CHIEF ELECTRICAL ENGINEER

1	7/7/99	AS-BID	
No.	Date	Revision	Approved

ENGINEERING DEPARTMENT

**WORLD
TRADE
CENTER**

ELECTRICAL

**FIRE ALARM SYSTEM
DEVICE UPGRADE
PHASE III**


5 WTC
PLAZA LEVEL
SMOKE DETECTOR
LAYOUT, INSTALLATION
AND REMOVAL,
SOUTH PART PLAN

This drawing subject to conditions in Contract. All inventions, ideas, designs and methods herein are reserved to Port Authority and may not be used without its written consent.

FELDSTEIN B. FAROUKI A.S.
Designed by Drawn by Checked by

MAY 31, 1999
Date

WTC-881,572 E-02-9S
Contract Number Drawing Number

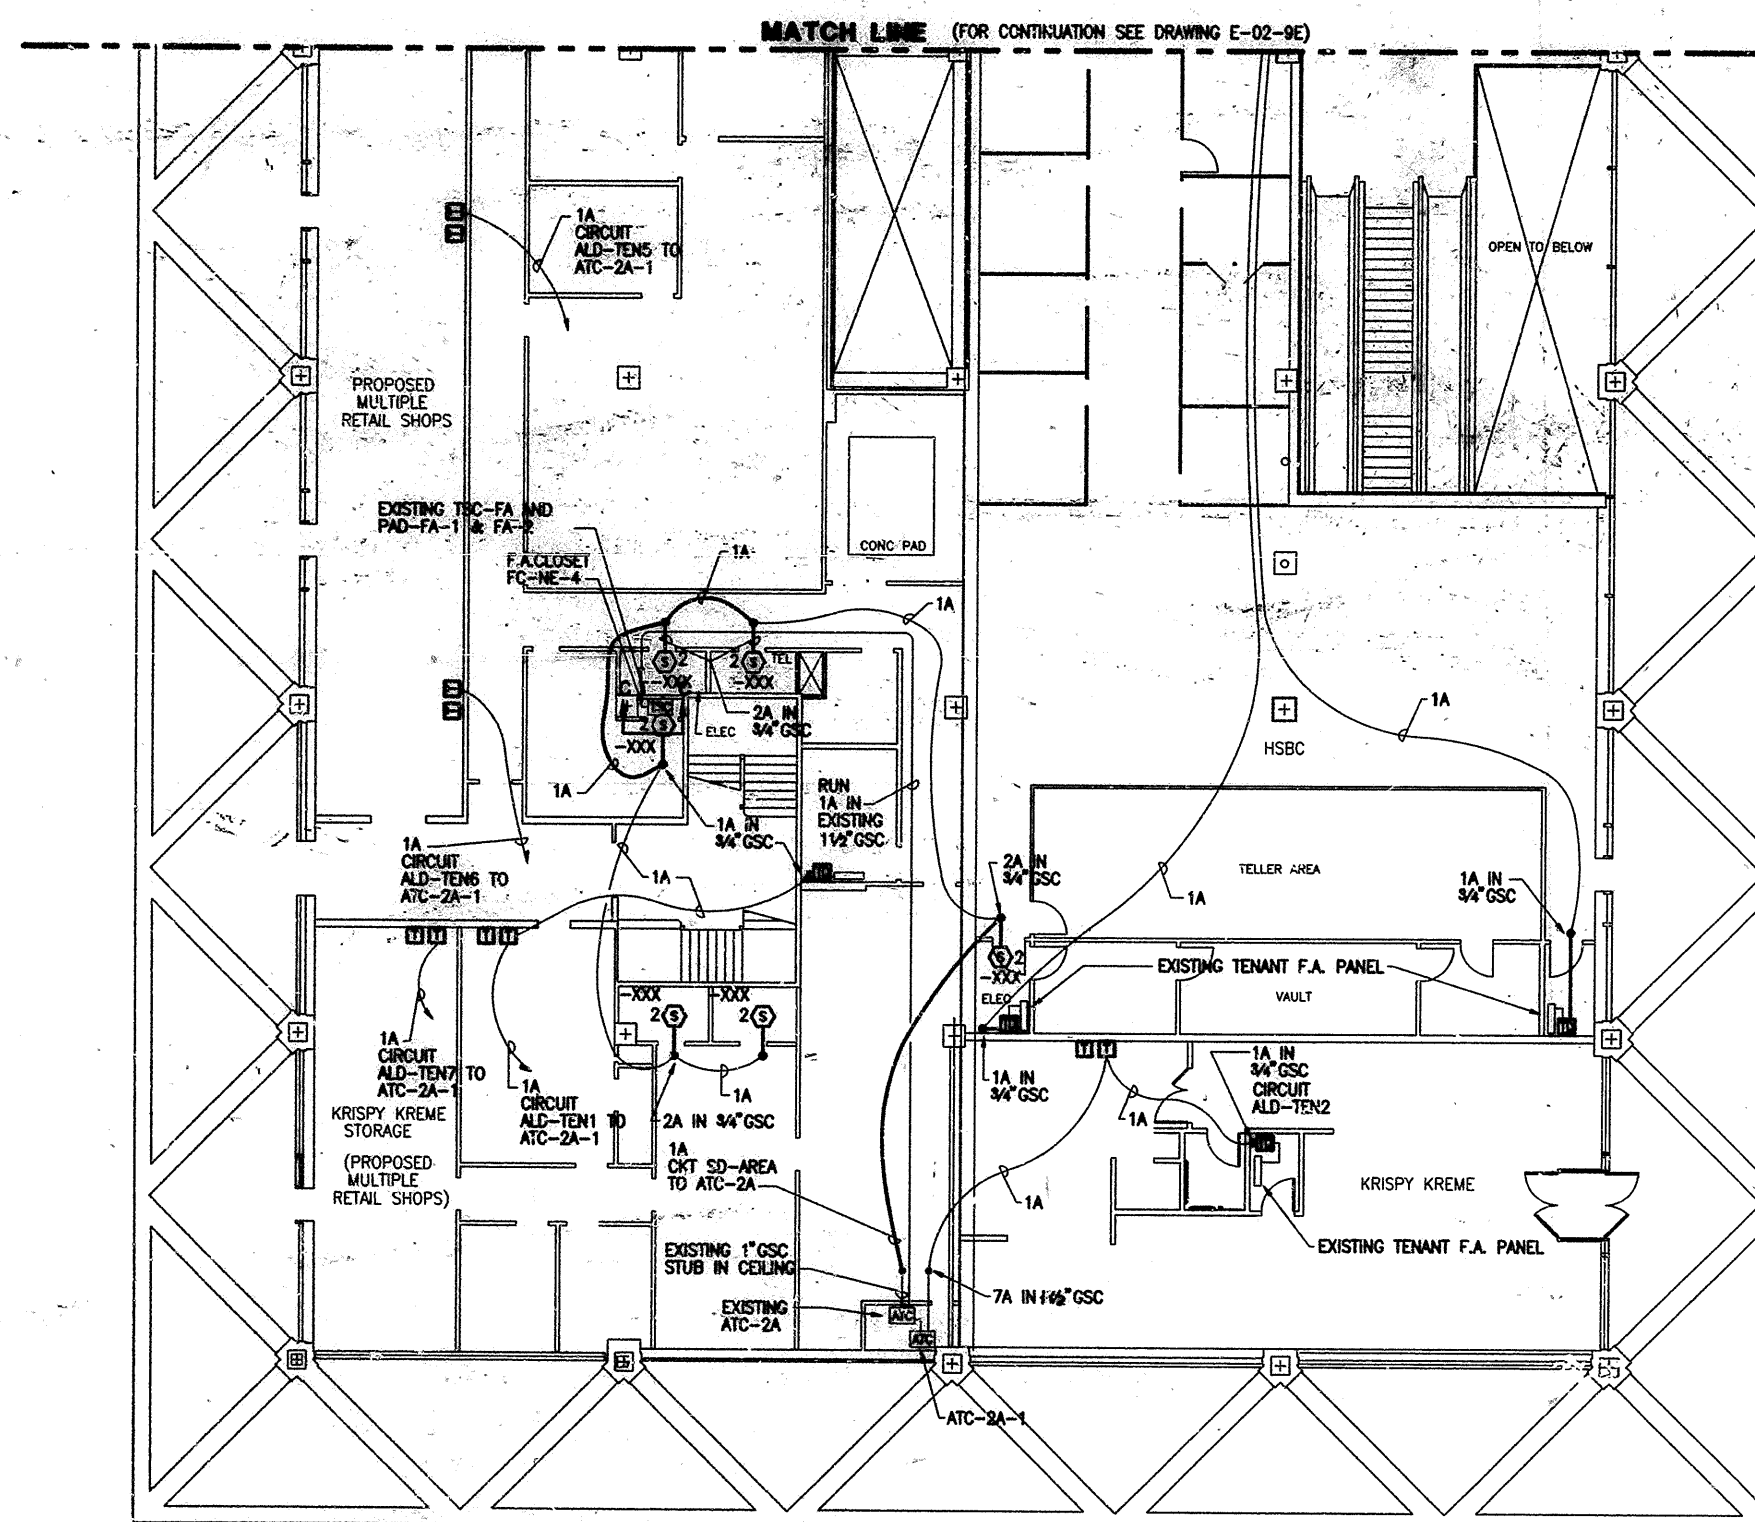

KEY PLAN
N.T.S.

0 12 24
SCALE IN FEET

FILE NAME: Y:\WC-881.572\PLAZA 5 WTC\FINISHED PLANS\E-02-09S.dwg plotted on 5/17/1999 by GJAMES